


Seymour Hannah Centre

Rink #2

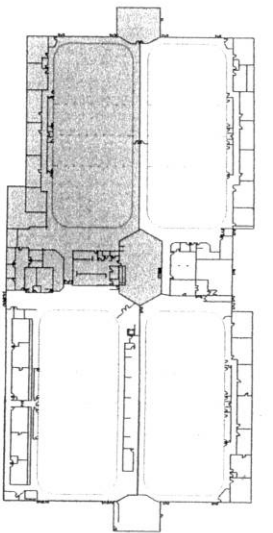

RINK #3


RINK #2

- Fire Alarm Annunciator Panel
- Fire Alarm Control Panel
- Heat Detector
- Smoke Detector
- Duct Type Smoke Detector
- Sprinkler Flow Switch
- Fire Alarm Manual Pull Station
- Fire Alarm Audible Signal Device
- Fire Alarm Visual Signal Device
- Magnetic Hold Open Device
- Sprinkler Main Control Valve
- Sprinkler Isolation Valve
- Exit Sign

SCHEMATIC LEGEND

- [FAAP] Fire Alarm Control Panel
- [FACE] Telephone Electrical Room
- [E] Emergency Light Head
- [H] Fire Hose Cabinet
- [E] Fire Extinguisher
- [M] Fixed Exting System Manual Pull
- [K] Kitchen Back-up Fire Extinguisher
- [S] Fire Department Staircase Connection
- [H] Fire Hydrant
- [H] Hydro Shut Off
- [H] Natural Gas Shut Off
- [H] Domestic Water Shut Off
- [K] Fire Dept. Key Box

- 4A T
- BE
- FR
- EV
- FA
- W

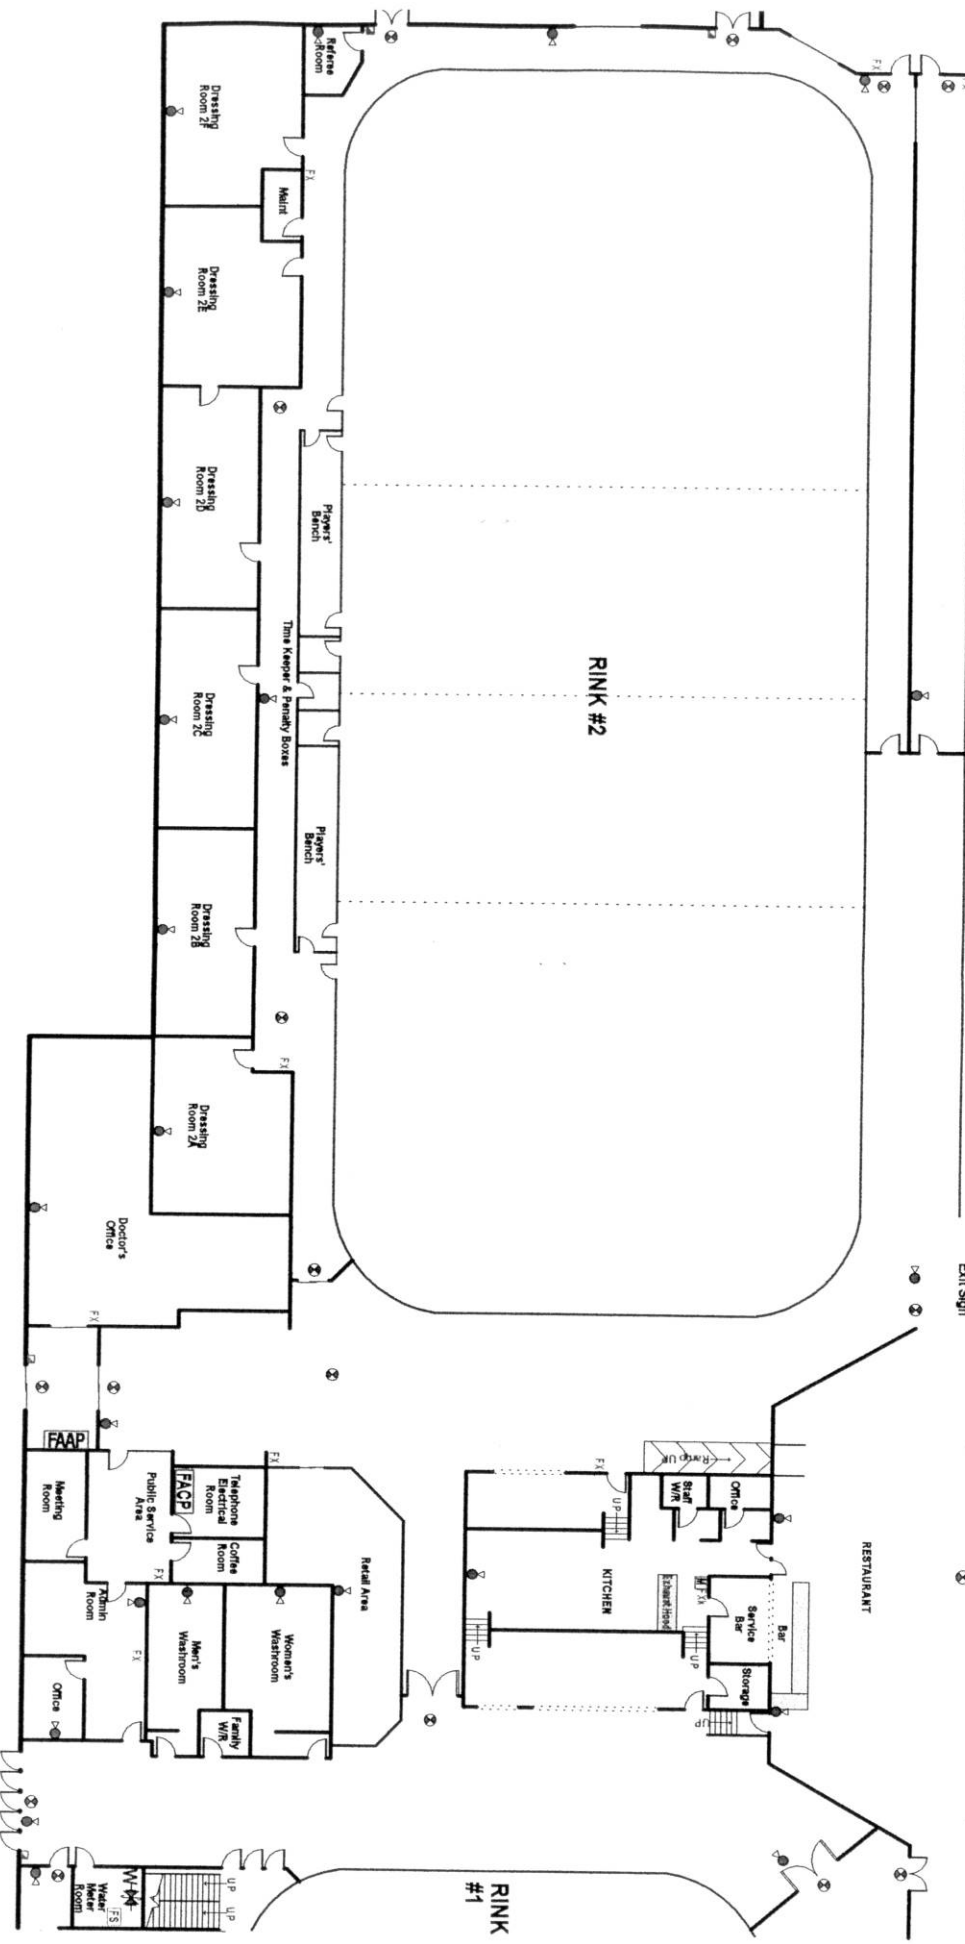

RINK #1