

Garden City Arenas


Jack Gatecliff Arena

1st Floor Plan

SCHEMATIC LEGEND

- Fire Alarm Annunciator Panel
- Fire Alarm Control Panel
- Heat Detector
- Smoke Detector
- Duct Type Smoke Detector
- Sprinkler Flow Switch
- Fire Alarm Manual Pull Station
- Fire Alarm Audible Signal Device
- Fire Alarm Visual Signal Device
- Magnetic Hold Open Device
- Sprinkler Main Control Valve
- Sprinkler Isolation Valve
- Exit Sign
- Emergency Light Head
- Emergency Light Battery Pack
- Fire Hose Cabinet
- Fire Extinguisher
- Fixed Exting. System Manual Pull
- Kitchen Back-up Fire Extinguisher
- Fire Department Slamesse Connection
- Fire Hydrant
- Hydro Shut Off
- Natural Gas Shut Off
- Domestic Water Shut Off
- Fire Dept. Key Box

- FAAP
- FAACP
- HD
- SD
- DTSD
- SFS
- FAMP
- FASD
- FASVSD
- MHO
- SMCV
- SI
- ES
- ELH
- ELBP
- FHC
- FX
- FXM
- FXK
- H
- CV
- DW
- W
- KB

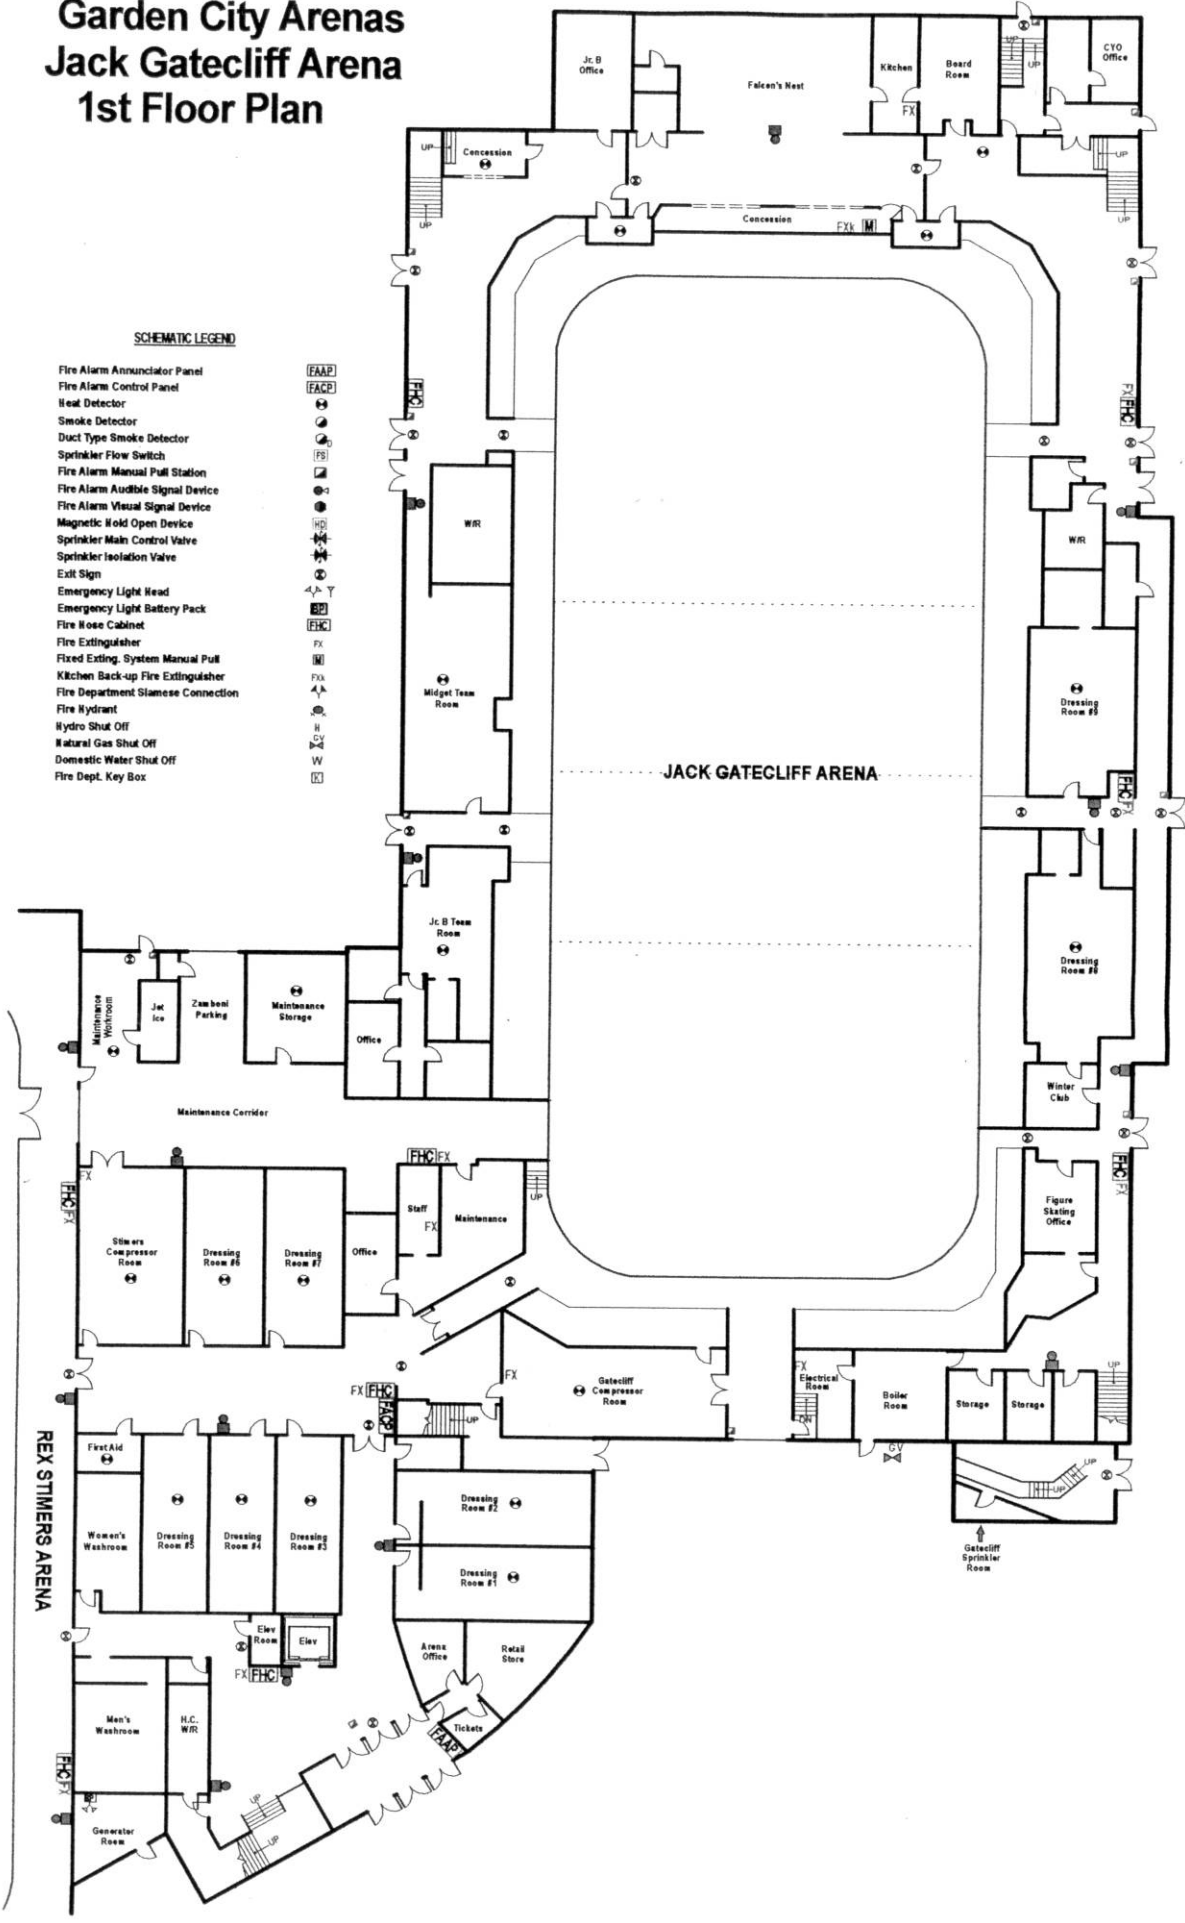


REX STIMERS ARENA


Garden City Arenas Jack Gatecliff Arena 2nd Floor Plan

SCHEMATIC LEGEND

- | | |
|------------------------------------|----------|
| Fire Alarm Annunciator Panel | [FAAP] |
| Fire Alarm Control Panel | [FACP] |
| Heat Detector | [HD] |
| Smoke Detector | [SD] |
| Duct Type Smoke Detector | [DSD] |
| Sprinkler Flow Switch | [FS] |
| Fire Alarm Manual Pull Station | [FAPS] |
| Fire Alarm Audible Signal Device | [FASD] |
| Fire Alarm Visual Signal Device | [FASVSD] |
| Magnetic Hold Open Device | [MHD] |
| Sprinkler Main Control Valve | [SMCV] |
| Sprinkler Isolation Valve | [SIV] |
| Exit Sign | [ES] |
| Emergency Light Head | [ELH] |
| Emergency Light Battery Pack | [ELBP] |
| Fire Hose Cabinet | [FHC] |
| Fire Extinguisher | [FX] |
| Fixed Exting. System Manual Pull | [FXM] |
| Kitchen Back-up Fire Extinguisher | [FXKB] |
| Fire Department Siamese Connection | [FDC] |
| Fire Hydrant | [FH] |
| Hydro Shut Off | [HSO] |
| Natural Gas Shut Off | [NGSO] |
| Domestic Water Shut Off | [DWSO] |
| Fire Dept. Key Box | [FKB] |

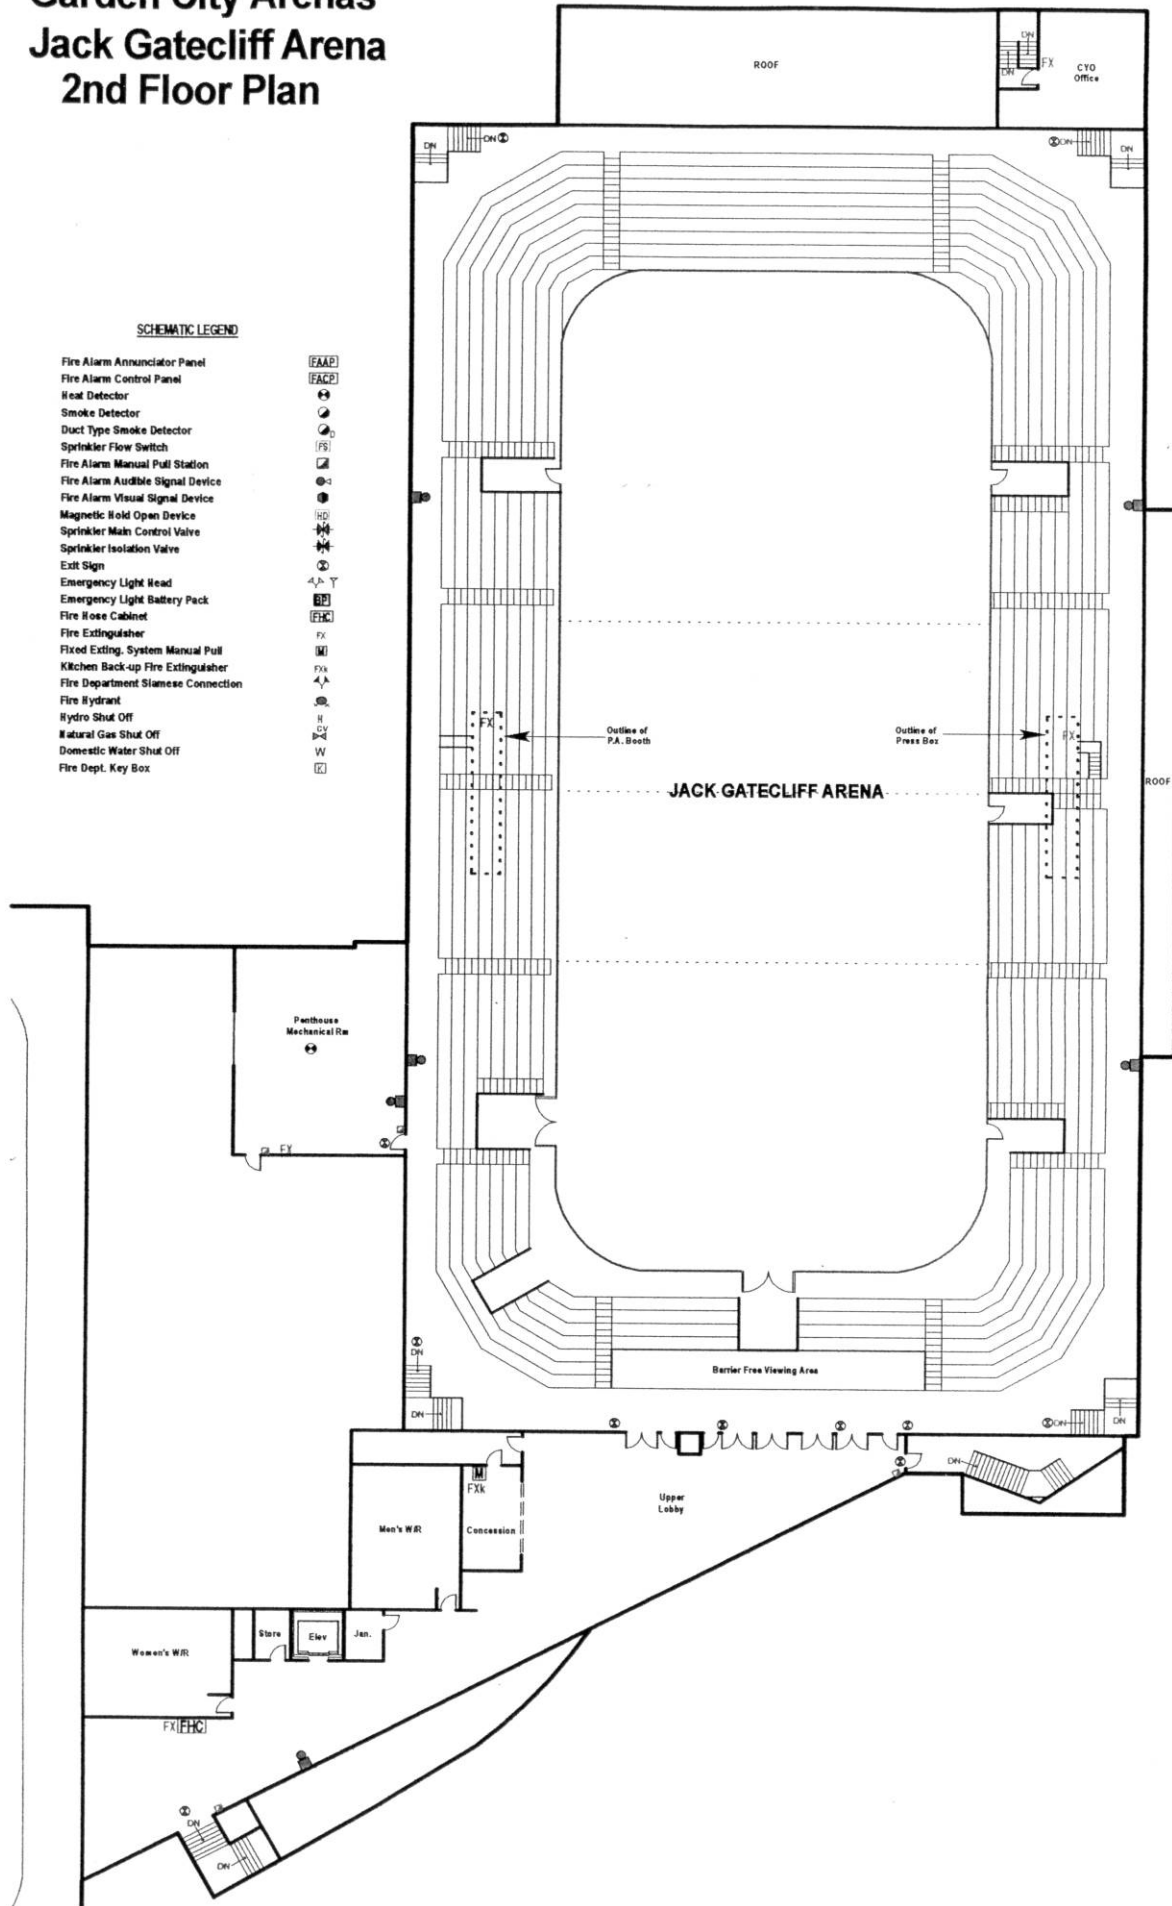

Garden City Arenas Rex Stimers Arena

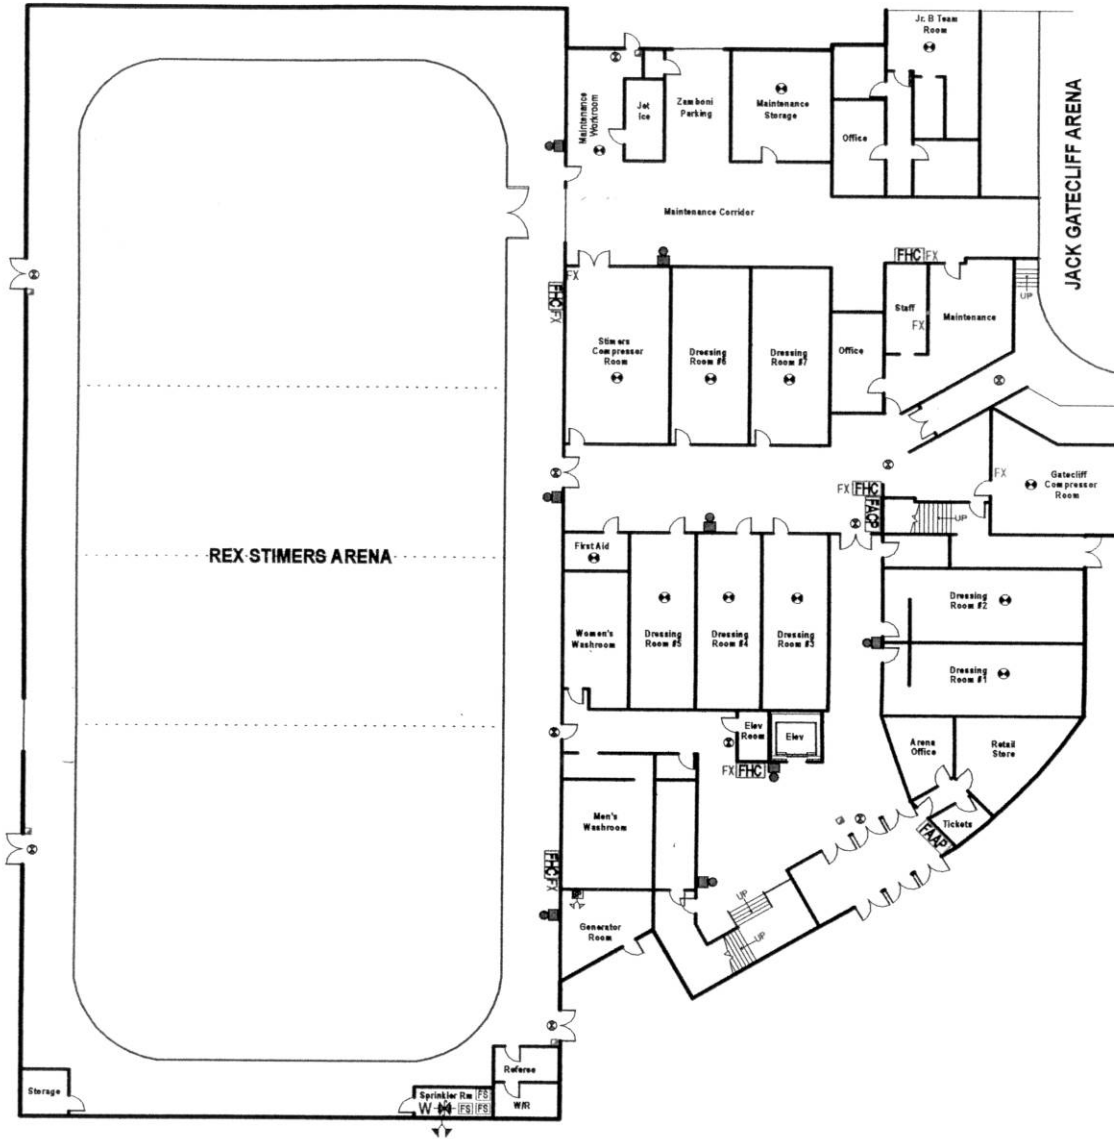

SCHEMATIC LEGEND

- Fire Alarm Annunciator Panel
- Fire Alarm Control Panel
- Heat Detector
- Smoke Detector
- Duct Type Smoke Detector
- Sprinkler Flow Switch
- Fire Alarm Manual Pull Station
- Fire Alarm Audible Signal Device
- Fire Alarm Visual Signal Device
- Magnetic Hold Open Device
- Sprinkler Main Control Valve
- Sprinkler Isolation Valve
- Exit Sign

- EAAP
- FACP
- FD
- SD
- ST
- SMPS
- KB
- FDSC
- FD
- HSO
- NGSO
- DWSO
- FDKB
- ELH
- ELBP
- FRC
- FX
- FXM
- FXK
- FXD
- FXS
- FXC
- FXH
- FXN
- FXO
- FXW
- FXK

- Emergency Light Head
- Emergency Light Battery Pack
- Fire Hose Cabinet
- Fire Extinguisher
- Fixed Exting. System Manual Pull
- Kitchen Back-up Fire Extinguisher
- Fire Department Siamese Connection
- Fire Hydrant
- Hydro Shut Off
- Natural Gas Shut Off
- Domestic Water Shut Off
- Fire Dept. Key Box
- Emergency Light Head
- Emergency Light Battery Pack
- Fire Hose Cabinet
- Fire Extinguisher
- Fixed Exting. System Manual Pull
- Kitchen Back-up Fire Extinguisher
- Fire Department Siamese Connection
- Fire Hydrant
- Hydro Shut Off
- Natural Gas Shut Off
- Domestic Water Shut Off
- Fire Dept. Key Box