



# Seymour Hannah Centre Rink #1

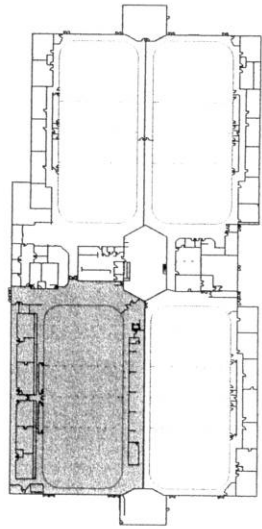



- arm Annunciator Panel
- arm Control Panel
- Detector
- /pe Smoke Detector
- arm Manual Pull Station
- arm Audible Signal Device
- ic Hold Open Device
- er Main Control Valve
- er Isolation Valve
- jm

- EMERGENCY LEGEND**
- Emergency Light Head
  - Emergency Light Battery Pack
  - Fire Hose Cabinet
  - Fire Extinguisher
  - Fixed Exting. System Manual Pull
  - Kitchen Back-up Fire Extinguisher
  - Fire Department Slammes Connection
  - Fire Hydrant
  - Hydro Shut Off
  - Natural Gas Shut Off
  - Domestic Water Shut Off
  - Fire Dept. Key Box

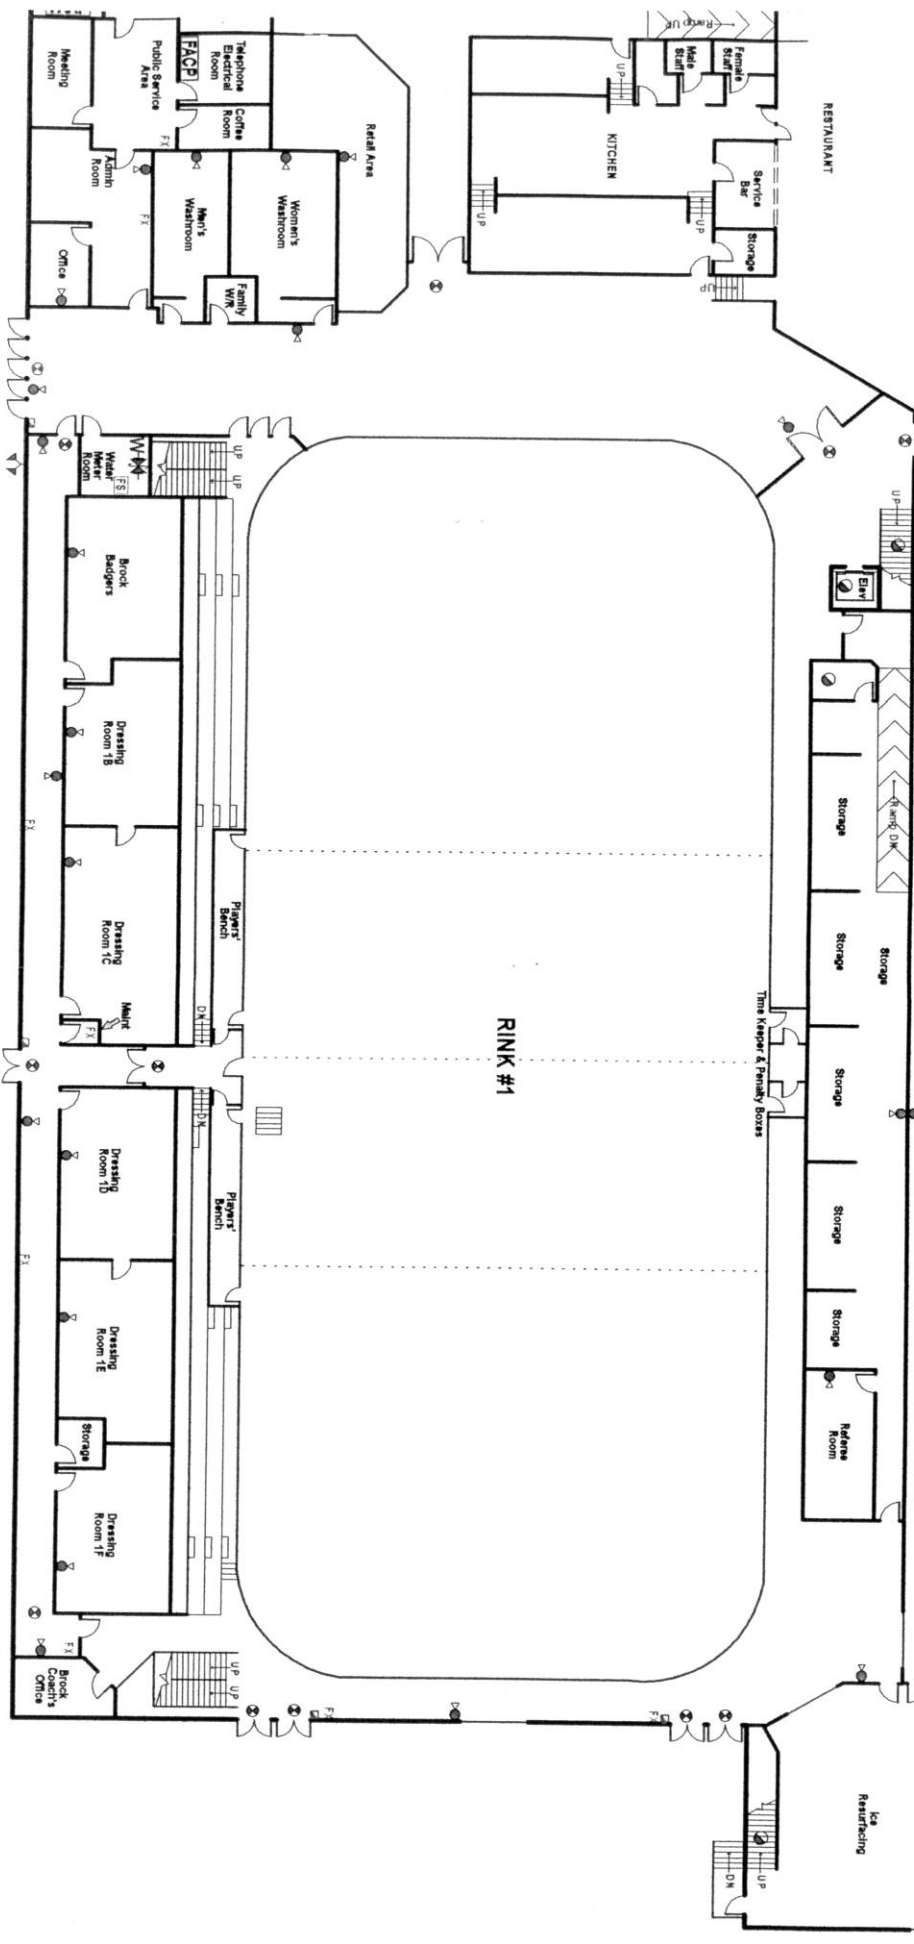

# Seymour Hannah Centre

## Rink #2

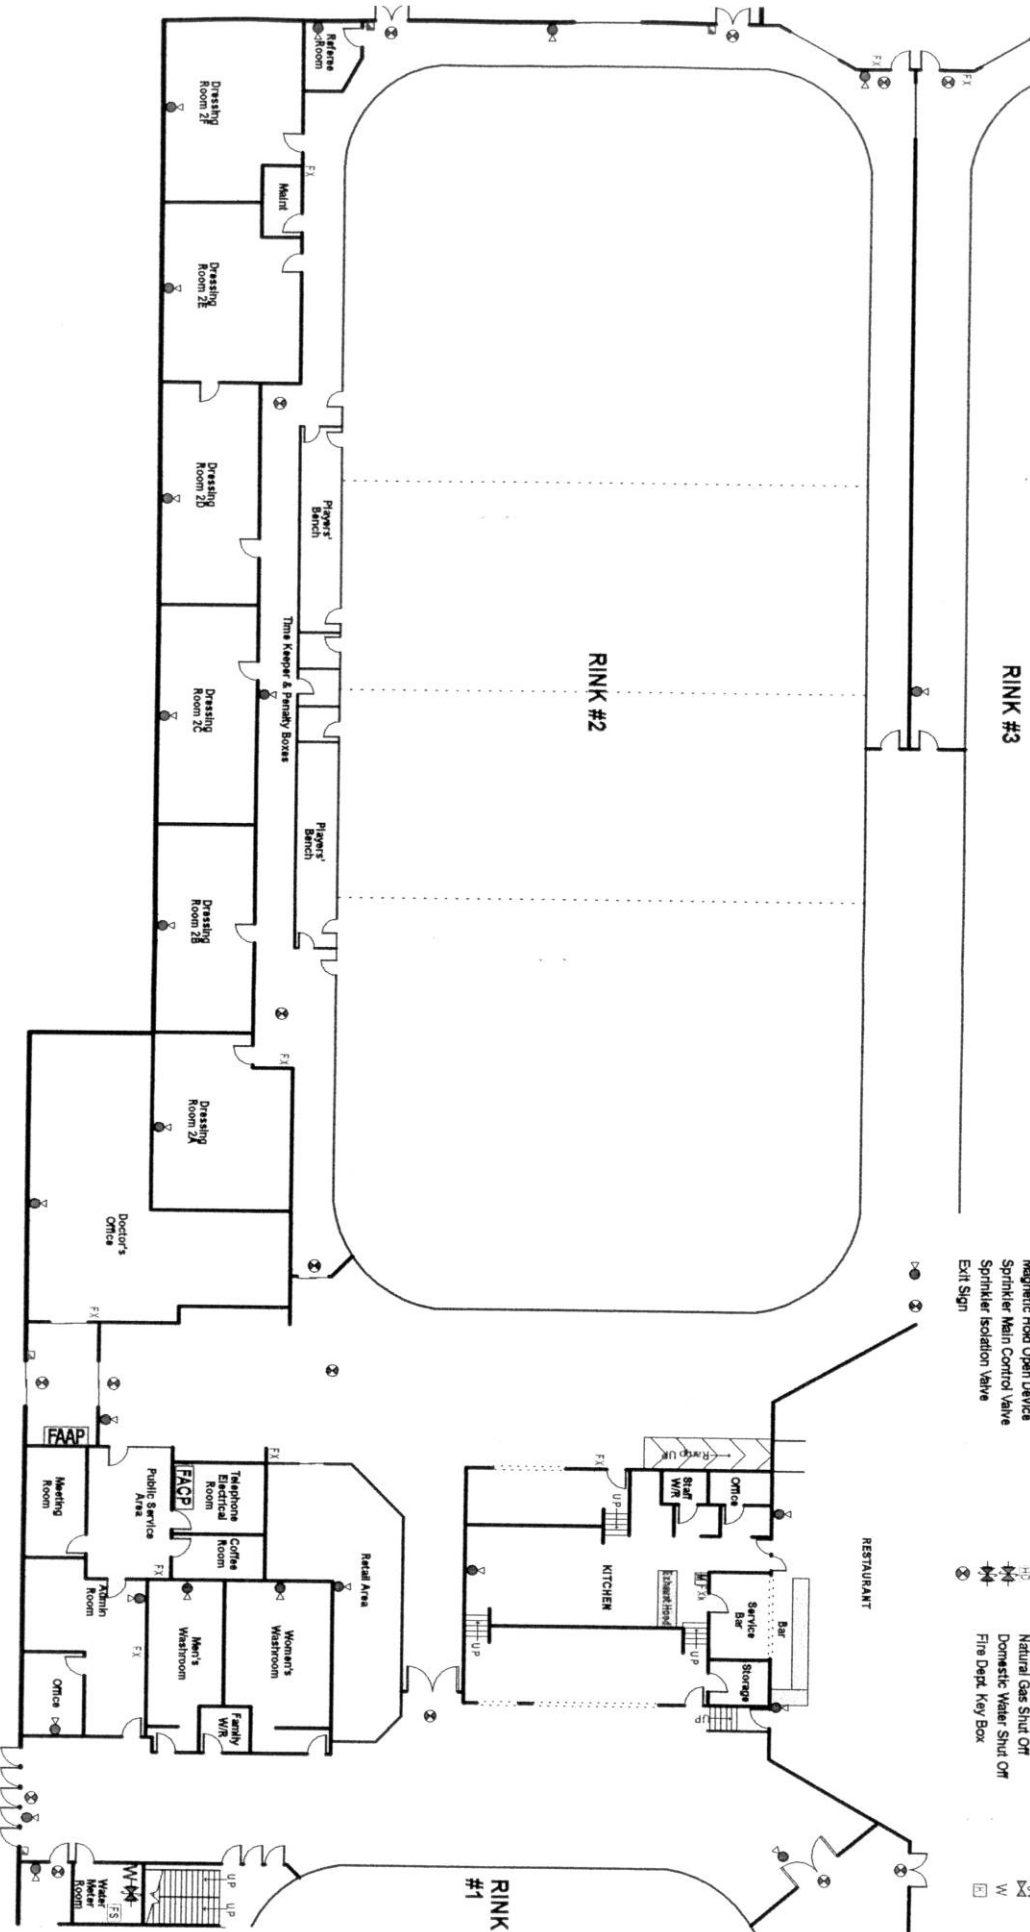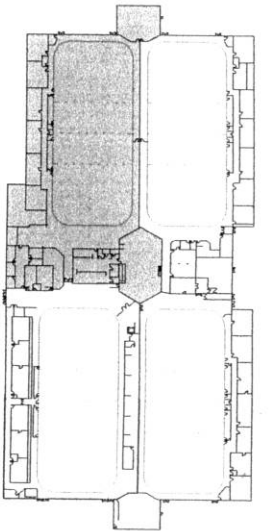

RINK #3

RINK #2


RINK #1

- Fire Alarm Annunciator Panel
- Fire Alarm Control Panel
- Heat Detector
- Smoke Detector
- Duct Type Smoke Detector
- Sprinkler Flow Switch
- Fire Alarm Manual Pull Station
- Fire Alarm Audible Signal Device
- Fire Alarm Visual Signal Device
- Magnetic Hold Open Device
- Sprinkler Main Control Valve
- Sprinkler Isolation Valve
- Exit Sign

### SCHEMATIC LEGEND


- [FAAP] Fire Alarm Annunciator Panel
- [FACP] Fire Alarm Control Panel
- [H.D.] Heat Detector
- [S.D.] Smoke Detector
- [D.T.S.D.] Duct Type Smoke Detector
- [S.F.S.] Sprinkler Flow Switch
- [F.A.M.P.S.] Fire Alarm Manual Pull Station
- [F.A.A.S.D.] Fire Alarm Audible Signal Device
- [F.A.V.S.D.] Fire Alarm Visual Signal Device
- [M.H.O.] Magnetic Hold Open Device
- [S.M.C.V.] Sprinkler Main Control Valve
- [S.I.V.] Sprinkler Isolation Valve
- [E.S.] Exit Sign
- [E.L.H.] Emergency Light Head
- [E.L.B.P.] Emergency Light Battery Pack
- [F.H.C.] Fire Hose Cabinet
- [F.E.] Fire Extinguisher
- [F.E.S.M.P.] Fixed Exting System Manual Pull
- [K.B.C.F.E.] Kitchen Back-up Fire Extinguisher
- [F.D.S.C.] Fire Department Staircase Connection
- [H.S.O.] Hydro Shut Off
- [N.G.S.O.] Natural Gas Shut Off
- [D.W.S.O.] Domestic Water Shut Off
- [F.D.K.B.] Fire Dept. Key Box

- 4A-T
- BE
- FHC
- EV
- M
- FA
- FA
- H
- N
- D
- W

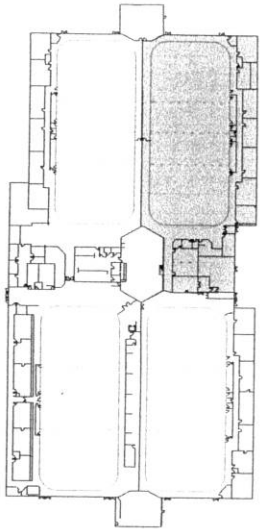

# Seymour Hannah Centre

## Rink #3

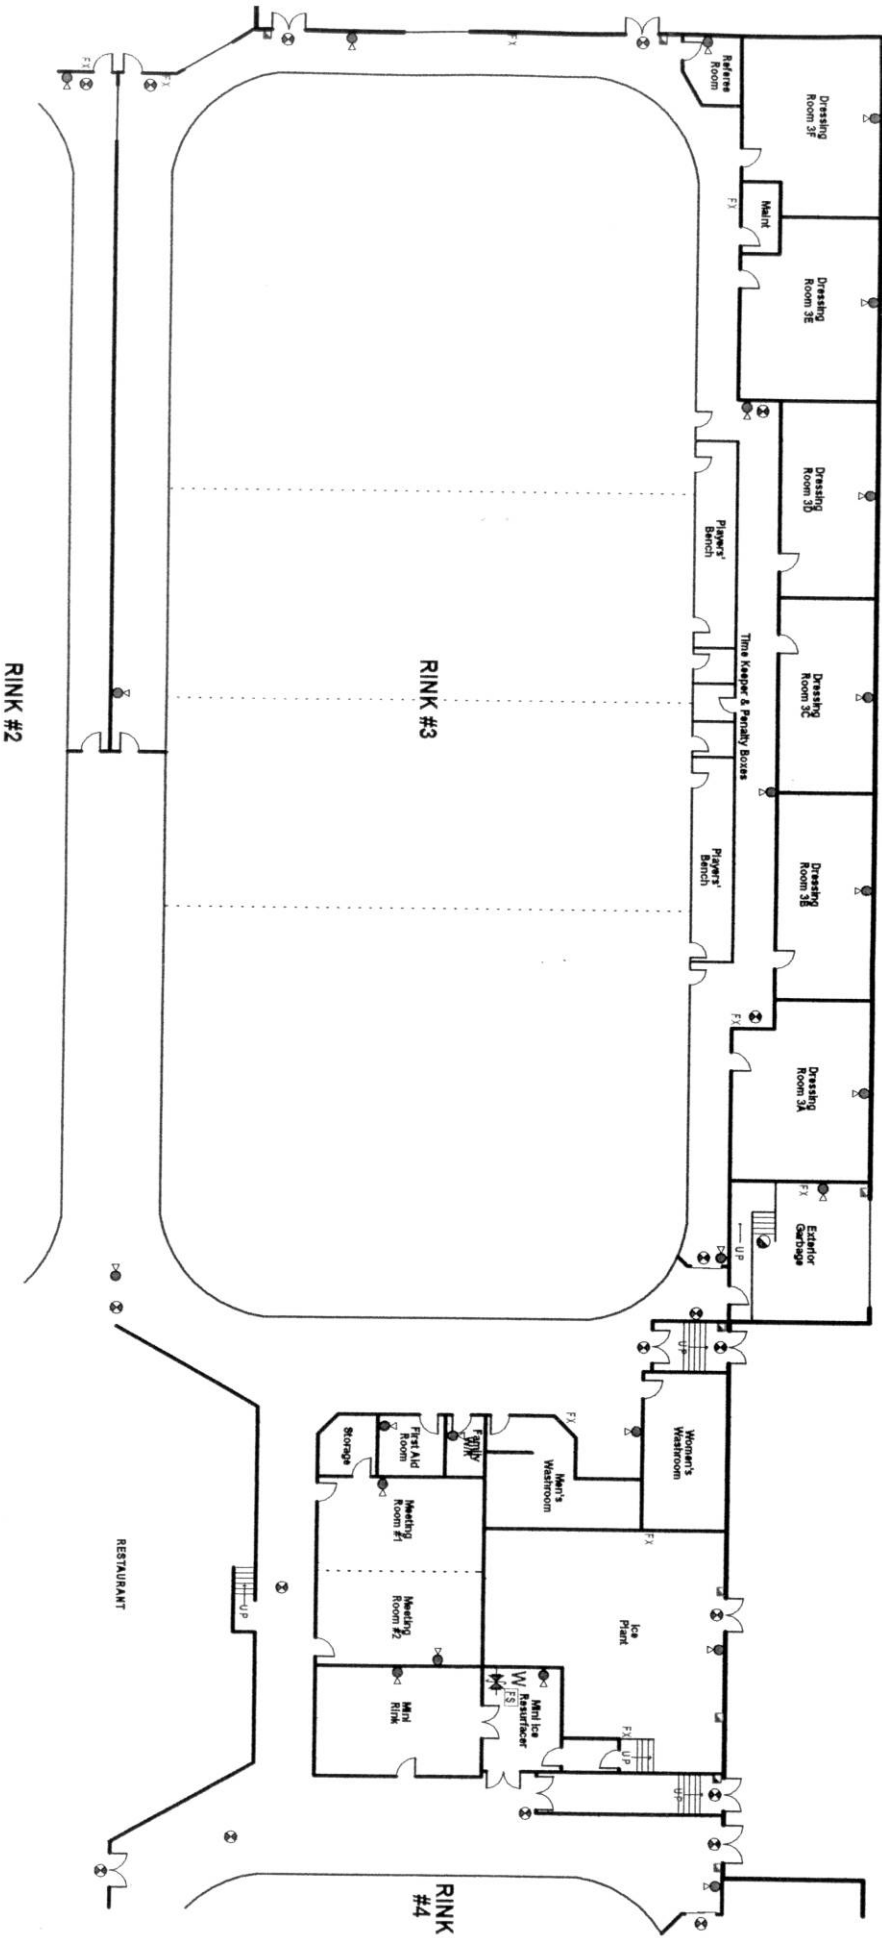


- Fire Alarm Annunciator Panel
- Fire Alarm Control Panel
- Heat Detector
- Smoke Detector
- Duct Type Smoke Detector
- Sprinkler Flow Switch
- Fire Alarm Manual Pull Station
- Fire Alarm Audible Signal Device
- Fire Alarm Visual Signal Device
- Magnetic Hold Open Device
- Sprinkler Main Control Valve
- Sprinkler Isolation Valve
- Exit Sign

- SCHEMATIC LEGEND**
- Emergency Light Head
  - Emergency Light Battery Pack
  - Fire Hose Cabinet
  - Fire Extinguisher
  - Fixed Exting. System Manual Pull
  - Kitchen Back-up Fire Extinguisher
  - Fire Department Samesse Connection
  - Fire Hydrant
  - Hydro Shut Off
  - Natural Gas Shut Off
  - Domestic Water Shut Off
  - Fire Dept. Key Box

- Emergency Light Head
- Emergency Light Battery Pack
- Fire Hose Cabinet
- Fire Extinguisher
- Fixed Exting. System Manual Pull
- Kitchen Back-up Fire Extinguisher
- Fire Department Samesse Connection
- Fire Hydrant
- Hydro Shut Off
- Natural Gas Shut Off
- Domestic Water Shut Off
- Fire Dept. Key Box


# Seymour Hannah Centre

## Rink #4

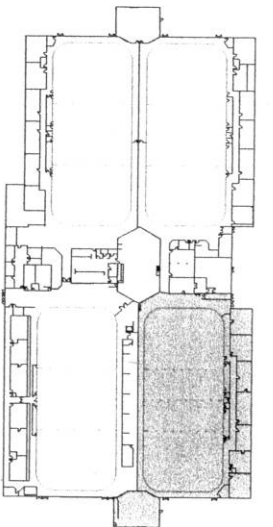

**SCHEMATIC LEGEND**

FAAP	Emergency Light Head	4, 5, 6, 7
FACEP	Emergency Light Battery Pack	BE
FC	Fire Hose Cabinet	FE
FD	Fire Extinguisher	FI
FE	Fixed Exting. System Manual Pull	FM
FE	Kitchen Back-up Fire Extinguisher	FK
FE	Fire Department Slamese Connection	FD
FD	Fire Hydrant	H
FD	Hydro Shut Off	HS
FD	Natural Gas Shut Off	NG
FD	Domestic Water Shut Off	DW
FD	Fire Dept. Key Box	W
FD		WB

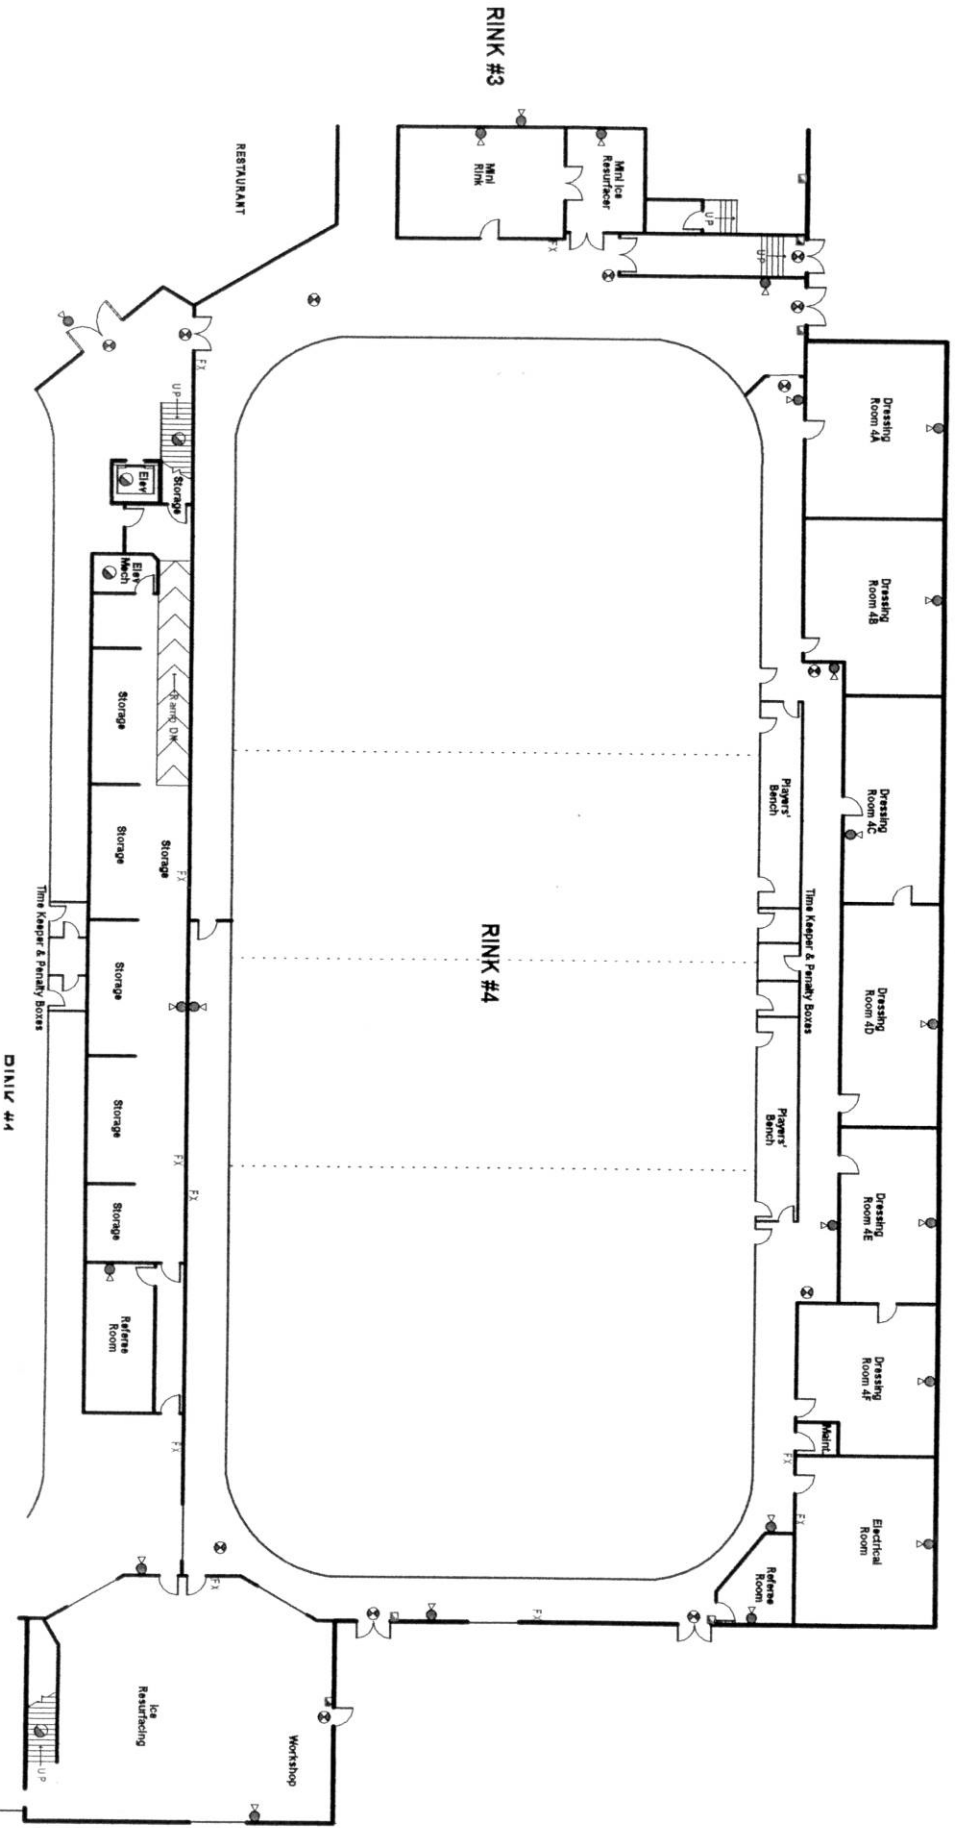

- Annunciator Panel
- Control Panel
- 10R
- 10T
- Smoke Detector
- 70W Switch
- Manual Pull Station
- Audible Signal Device
- Visual Signal Device
- Main Control Valve
- Isolation Valve